



Test Report for

Suape Textil S/A
Rodovia PE-60, km 7,5
Distrito Industrial Portuario de Suape
Cabo de Santo Agostinho – PE
CEP 54500-000
Brazil

Single layer
Nomex® Comfort, 93% meta-aramid, 5% para-aramid, 2% anti-static
Sample colours: 7514 / 9570 / 3840 / 2235
Nominal weight 6 oz/yd²

ARC RATING by ASTM F1959-05

*Standard Test Method for Determining Arc Thermal Performance of Textile Materials
for Clothing by Electric Arc Exposure Method*

Kinectrics Inc. Report No.: K-418108-001-R00

April 28, 2008

PRIVATE INFORMATION

Kinectrics will not release details, or copies, of the report without the permission of the client.

Note about this report

- The test performed does not apply to electrical contact or electrical shock hazard
- The test result is applicable only to the Test Item, other material or color may have different protection level
- The findings of this report are based on the current test method as described in the Reference Standard
- It is assumed that the information supplied by the client was valid and complete

All tests were done under Kinectrics Quality Management System registered to ISO 9001 :2000 by QMI. Kinectrics Inc takes reasonable steps to ensure that all work performed shall meet the industry standards and that all reports shall be reasonably free of errors, inaccuracies or omissions. KINETRICS INC. DOES NOT MAKE ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, WITH RESPECT TO THE MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE OF ANY INFORMATION CONTAINED IN THIS REPORT OR THE RESPECTIVE WORKS OR SERVICES SUPPLIED OR PERFORMED BY KINETRICS INC. Kinectrics Inc. does not accept any liability for any damages, either directly, consequentially or otherwise resulting from the use of this report.

© Kinectrics Inc., 2008. THIS REPORT IS PROTECTED BY COPYRIGHT. Any reproduction distribution or copying, either in whole or in part, without Client's permission is prohibited.

Kinectrics Inc., 800 Kipling Avenue, Toronto, Ontario M8Z 6C4
Tel: 416-207-6305, FAX: 416-207-5717,
www.kinectrics.com

TEST REPORT

Test item: Single layer
Nomex® Comfort, 93% meta-aramid, 5% para-aramid, 2% anti-static
Four different colours provided in test lot.
Nominal weight 6 oz/yd²
Measured weight before test:
 Colour 7514, weight 6.4 oz/yd²
 Colour 9570, weight 6.5 oz/yd²
 Colour 3840, weight 6.5 oz/yd²
 Colour 2235, weight 6.4 oz/yd²

Laundering: Samples tested as received. Laundering and preparation done by Suape Textil S/A

Test Performed: Determination of the arc thermal performance value of material for use as flame resistant clothing for workers exposed to electric arcs.

Reference Standard: **ASTM F1959-05**, *Standard Test Method for Determining Arc Thermal Performance of Textile Materials for Clothing by Electric Arc Exposure Method*

RESULTS

Flat Panel Samples:

- | | |
|---------------------------------|--|
| • Arc Rating, ATPV: | 7.0 cal/cm² |
| • Heat Attenuation Factor, HAF: | 64.6 % |
| • After flame: | Only 1 sample has 2 sec after-flame |
| • Break-open: | no samples having break-open |

Notes and Observations:

- Test Parameters: Arc Gap= 30 cm, distance to the arc = 30 cm
- Arc current = 8 kA rms, duration of the arc was varied as indicated in Table 1
- At ATPV level
 - Surface is discoloured and charred.
 - Back has discolouration.
 - Fabric has no melting or dripping

Garment Samples: No garments evaluated.

Description of Test Method

The Arc Rating is determined by the arc test method defined in the Reference Standard using material in the form of flat specimens. This test method determines the heat transport response through a fabric or fabric system when exposed to the heat energy from an electric arc. The heat transport response is assessed versus the Stoll curve, an approximate human tissue tolerance predictive model that projects the onset of a second-degree burn injury.

Once the burns are recorded, the determination of the ATPV is done by logistic regression. The logistic regression is an S-shaped distribution function as shown in Figure 1. The Arc Rating ATPV determined by this test method is the amount of energy that predicts a 50% probability of a second degree burn. When break-open of the last FR layer is observed, the analysis of the break-open threshold is performed to determine if this may occur first. The Arc Rating of the fabric is which ever occurs first, this is the lower value of the two.

Because of the variability of the arc exposure, different heat transmission values may be observed at individual panel sensors or incident energy monitors. The evaluation of each sensor is done in accordance with the procedure specified in the Reference Standard.

To allow the fabric to normalize to the environment, the fabric is kept in air-conditioned laboratory conditions for a minimum of 24 hrs before the test. The weight (density) of the fabric is one of the major factors affecting its thermal performance. For this reason, the density of the fabric is measured before the testing. This is an accurate process using die cut samples and a precision scale. The design density of the fabric reported by the manufacturer may be different from the density indicated in the Kinectrics test report for various reasons. The reported value is the density of the material at the time of the test. Factors including but not limited to the manufacturing process and shrinkage during laundering will affect the density of the material.

Individual test sheets, graphs, photographs of the samples and video of every test are provided in digital format to the Client for review.

Reported by:

Reviewed by:

Colin Zhou, Technologist
High Current Laboratory

Claude Maurice, CET, BASc
Test manager
High Current Laboratory
claudio.maurice@kinectrics.com

Terminology

Arc Rating, n —value attributed to materials that describes their performance to exposure to an electrical arc discharge. The arc rating is expressed in cal/cm^2 and is derived from the determined value of ATPV or E_{BT50} (should a material system exhibit a breakopen response below the ATPV value)

Arc Thermal Performance Value (ATPV), the incident energy on a fabric or material that results in a 50 % probability that sufficient heat transfer through the tested specimen is predicted to cause the onset of a second-degree skin burn injury based on the Stoll¹ curve.

Breakopen threshold energy (E_{BT50}), n —the incident energy on a fabric or material that results in a 50 % probability that sufficient heat transfer through the tested specimen is predicted to cause the tested specimen to break open. The specimen is considered to exhibit breakopen when any hole is at least 1.6 cm^2 [0.5 in.^2] in area or at least 2.5 cm [1.0 in.] in any dimension. In multiple layer specimens of flame resistant material, all the layers must breakopen to meet the definition. In multiple layer specimens, if some of the layers are ignitable, breakopen occurs when these layers are exposed.

Heat Attenuation Factor, HAF, n — in arc testing, the percent of the incident energy that is blocked by a material.


Stoll curve¹, n — an empirical predicted second-degree skin burn injury model, also commonly referred to as the *Stoll Response*.

SCD (Stoll Curve Difference)—The time dependent averaged heat energy response for each panel is compared to the Stoll Curve. A second-degree skin burn injury is predicted if the panel sensor heat energy response exceeds the Stoll Response value at any time (positive SCD). If the sensor response is below the Stoll Curve, no burn injury is predicted and a negative SCD is recorded.

¹Derived from: Stoll, A. M. and Chianta, M. A., "Method and Rating System for Evaluations of Thermal Protection," *Aerospace Medicine*, Vol 40, 1969, pp. 1232-1238 and Stoll, A. M. and Chianta, M. A., "Heat Transfer through Fabrics as Related to Thermal Injury," *Transactions—New York Academy of Sciences*, Vol 33 (7), Nov. 1971, pp. 649-670.


Figure 1: Determination of arc rating

Fabric Nomex® Comfort 6 oz/y². Blend: 93% meta-aramid/ 5% para-aramid/ 2% anti-static.
Description: In 4 colours: navy-7514 weight 6.4 oz/y², blue-9570 weight 6.5 oz/y², khaki-3840 weight 6.5 oz/y², orange-2235 weight 6.4 oz/y²

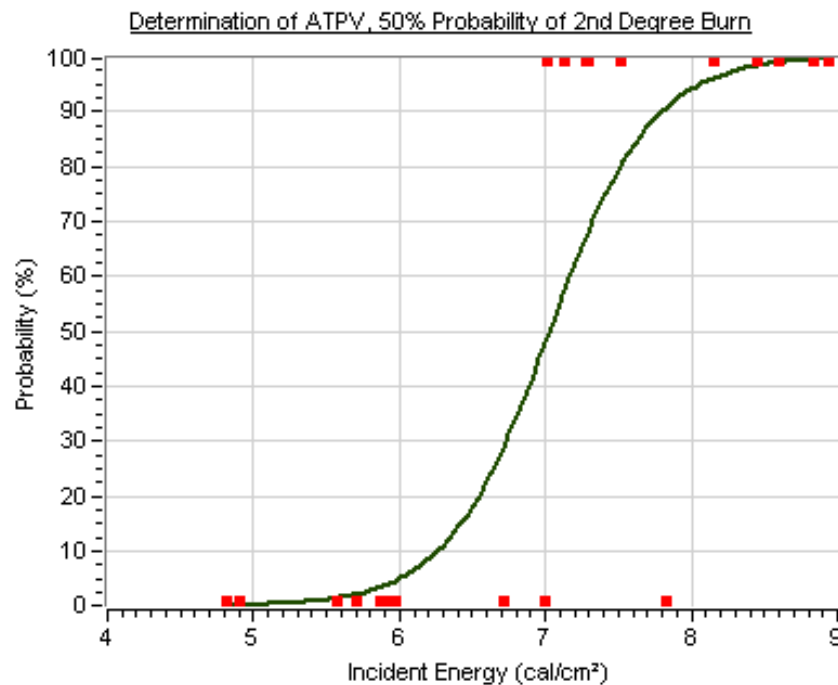**ATPV = 7.0 cal/cm²**

Probability of Burn	Ei
5%	6.0
10%	6.3
20%	6.5
30%	6.7
40%	6.9
50%	7.0
60%	7.2
70%	7.3
80%	7.5
90%	7.8

Pts = 21
 # Pts above Stoll = 10
 # Pts Break-Open = 0
 # Pts always >STOLL = 5
 # Pts always <STOLL = 10
 # Pts within 20% = 13
 # Pts in mix zone = 6

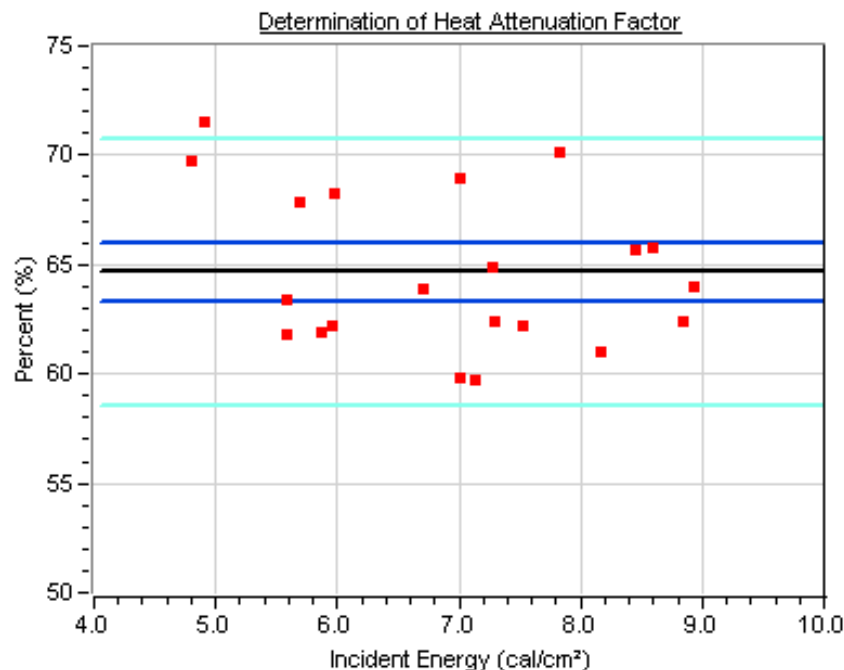**HAF = 64.6 %**

Confidence Intervals
 95% CI = 63.3 , 66.0






Data pts 
 Best Fit 
 95% CI 
 95% CI pts 

Table 1: Summary of test shots with energy and observations


Fabric Description: Nomex® Comfort 6 oz/y². Blend: 93% meta-aramid/ 5% para-aramid/ 2% anti-static.
In 4 colours: navy-7514 weight 6.4 oz/y², blue-9570 weight 6.5 oz/y², khaki-3840 weight 6.5 oz/y², orange-2235 weight 6.4 oz/y²

[illegible]

Test 08-1949, Panel A: 7.8 cal/cm², Panel B: 6.0 cal/cm², Panel C: 7.0 cal/cm², near the ATPV level
Surface is discoloured and charred.
Back has discolouration.

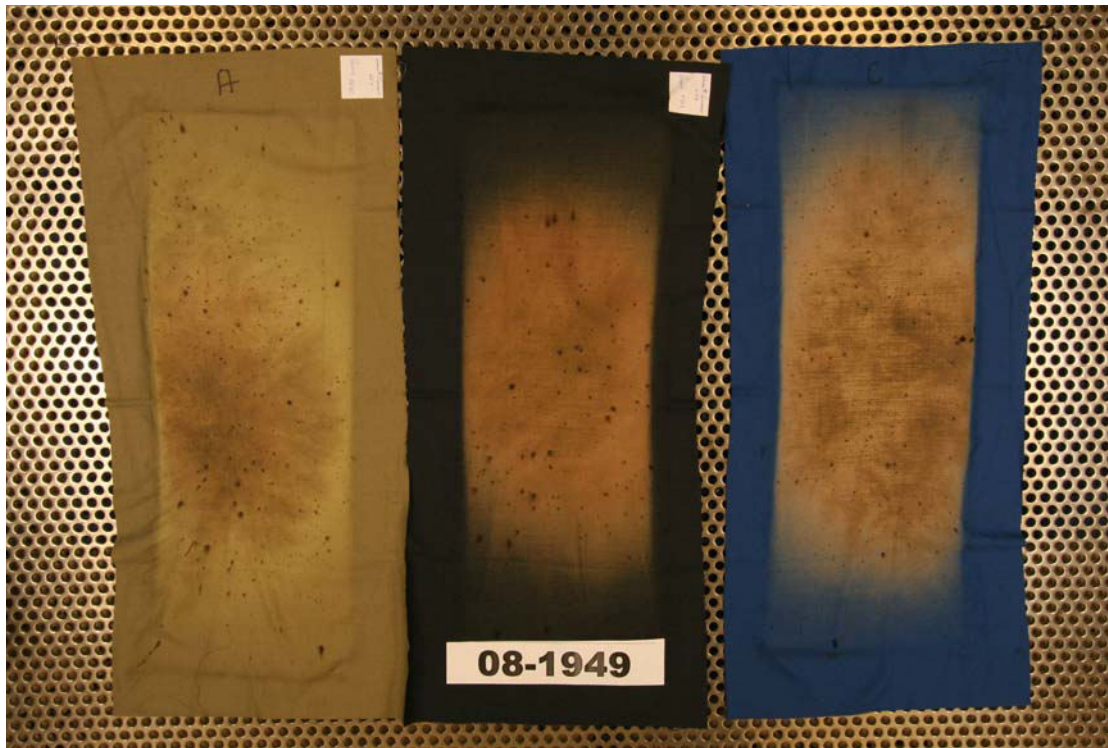

**Test 08-1954, Panel A: 6.7 cal/cm², Panel B: 5.9 cal/cm², Panel C: 5.6 cal/cm²,
Surface is discoloured and charred.
Back has discolouration, fabric not weak**

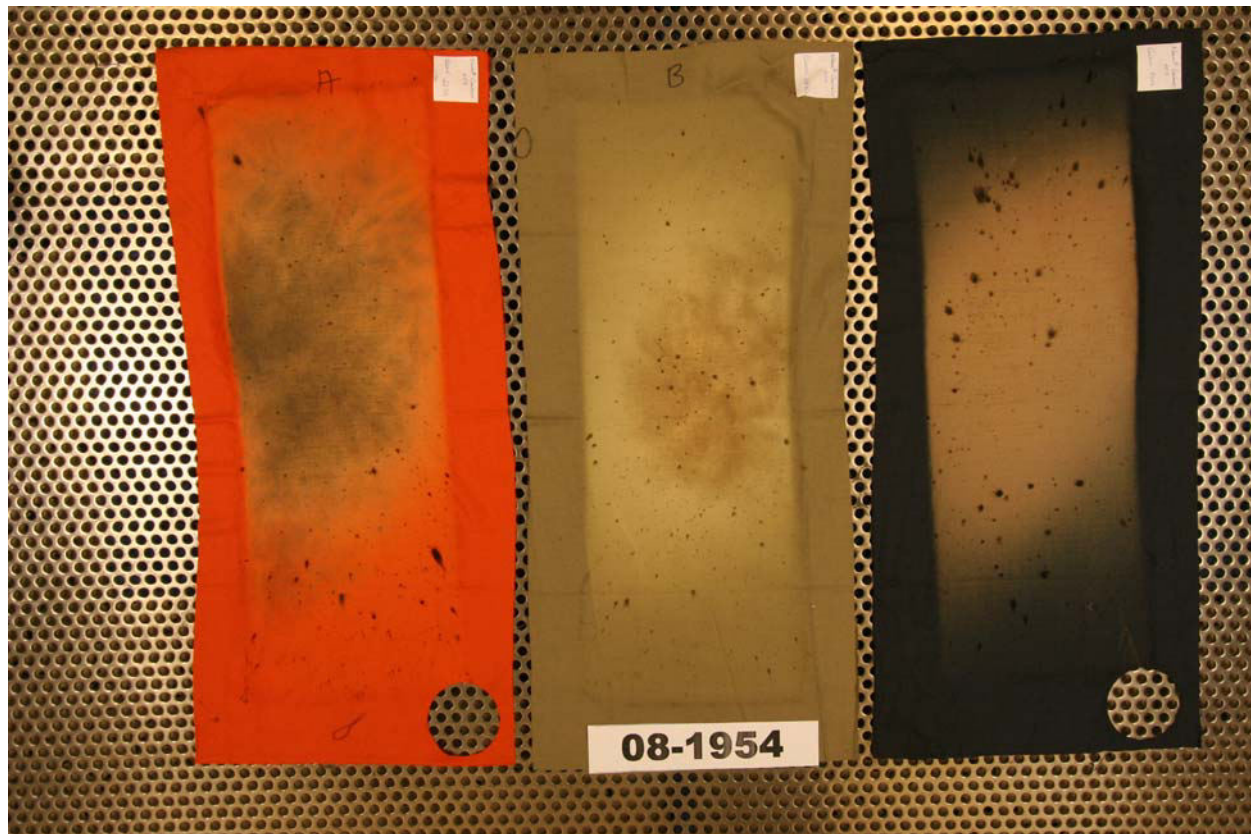

CERTIFICATE OF COMPLIANCE

Certificate Number MH46575
Report Reference MH46575-20190810
Issue Date 2022-MAY-18

Issued to: DUPONT SPECIALTY PRODUCTS USA, LLC
5401 JEFFERSON DAVIS HWY
RICHMOND VA 23234

**This certificate confirms that
representative samples of**

COMPONENT – FLAME RESISTANT CLOTHING FOR
PROTECTION OF INDUSTRIAL PERSONNEL AGAINST
SHORT-DURATION EXPOSURES FROM FIRE

See Attached Table

Have been investigated by UL in accordance with the
component requirements in the Standard(s) indicated on
this Certificate. UL Recognized components are incomplete
in certain constructional features or restricted in
performance capabilities and are intended for installation in
complete equipment submitted for investigation to UL LLC.


Standard(s) for Safety: NFPA 2112, Standard on Flame-Resistant Garments for
Protection of Industrial Personnel Against Short Duration
Thermal Exposures from Fire, 2018 Edition

Additional Information: See the UL Online Certifications Directory at
<https://iq.ulprospector.com> for additional information.

This *Certificate of Compliance* does not provide authorization to apply the UL Recognized Component Mark. Only
the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Recognized Component Mark should be considered as being UL Certified
and covered under UL's Follow-Up Services.

Look for the UL Recognized Component Mark on the product.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please
contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>




CERTIFICATE OF COMPLIANCE

Certificate Number MH46575
Report Reference MH46575-20190810
Issue Date 2022-MAY-18

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Style Designation	Weight (oz/yd ²)	Material Composition	Weave/ Knit	Finish
Nomex Comfort: NCFAB6xxx0xx45PWZA, NCFABAxxx0xx45PWZA	4.5	98% Nomex® and Kevlar® /2% Anti-Stat	Plain	None
Nomex Comfort: NCFAB6xxxWxx45PWZA OR NCFABAxxxWxx45PWZA	4.5	98% Nomex® and Kevlar® /2% P140 Anti-Stat	Plain	Wicking
NCFABBxxxWxx45PWZA	4.5	98% Nomex® and Kevlar®, 2% Anti-Stat	Plain	Wicking
Nomex Comfort: NCFAB6xxx0xx602TZA, NCFABAxxx0xx602TZA	6.0	98% Nomex® and Kevlar® /2% Anti-Stat	Twill	None
Nomex Comfort: NCFAB6xxxWxx602TZA OR NCFABAxxxWxx602TZA	6.0	98% Nomex® and Kevlar® /2% P140 Anti-Stat	Twill	Wicking
NCFABBxxxWxx602TZA	6.0	98% Nomex® and Kevlar®, 2% Anti-Stat	Twill	Wicking



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>

